


- A1, A2 = Alarm
- D1 = Remote Display Module 040
- F1 = Flow Switch
- P1 = Boiler Pump
- P2 = Variable Speed Injection Pump
- P3A, B = Mix System Pump
- S1 = Boiler Supply Sensor 071
- S2, S5 = Outdoor Sensor 070
- S3 = Mix Supply Sensor 071
- S4 = Boiler Return Sensor 071
- S6 = Slab Sensor 072/073
- S7 = Mix Return Sensor 071
- V1 = Balancing Valve or Globe Valve

#### Concept Drawing

This is only a concept drawing, not an engineered drawing. It is not intended to describe a complete system, nor any particular system. It is up to the system designer to determine the necessary components for and configuration of the particular system being designed, including additional equipment, isolation relays (for loads greater than the control's specified output ratings), and any safety devices which in the judgement of the designer are appropriate, in order to properly size, configure and design that system and to ensure compliance with building and safety code requirements.

#### System Operation

XXXX

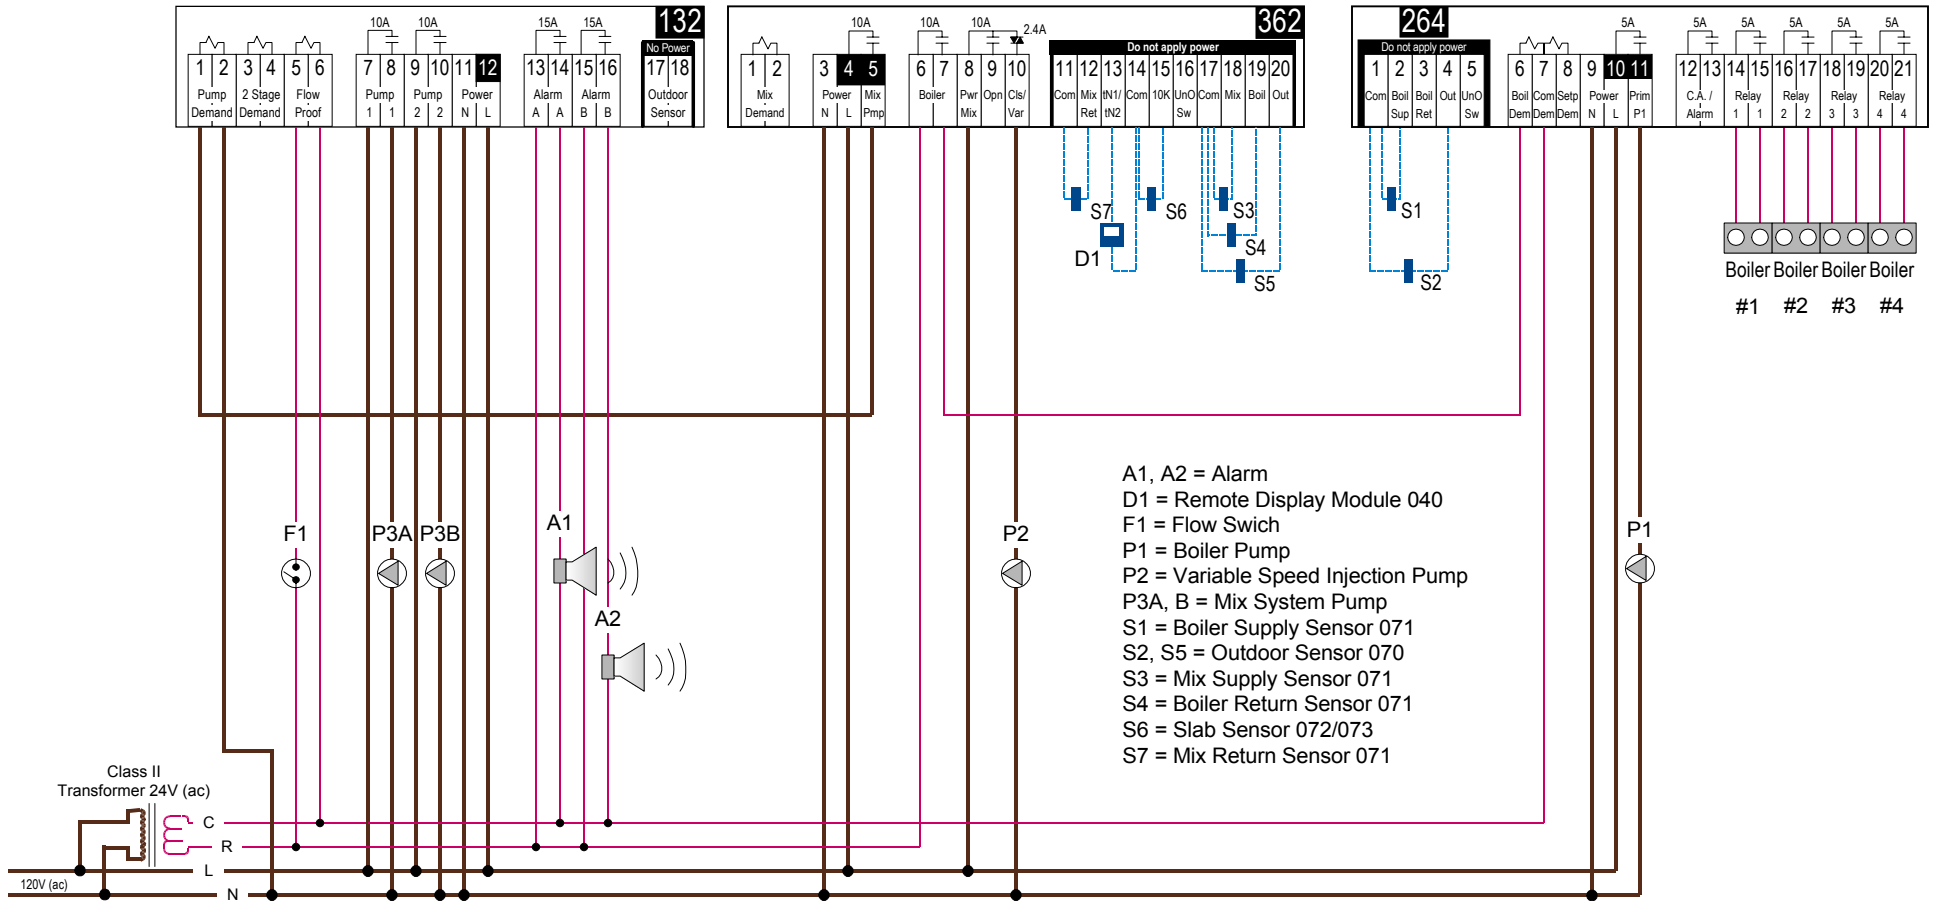

### Concept Drawing

This is only a concept drawing, not an engineered drawing. It is not intended to describe a complete system, nor any particular system. It is up to the system designer to determine the necessary components for and configuration of the particular system being designed, including additional equipment, isolation relays (for loads greater than the control's specified output ratings), and any safety devices which in the judgement of the designer are appropriate, in order to properly size, configure and design that system and to ensure compliance with building and safety code requirements.

### Essential Control Settings

XXXX